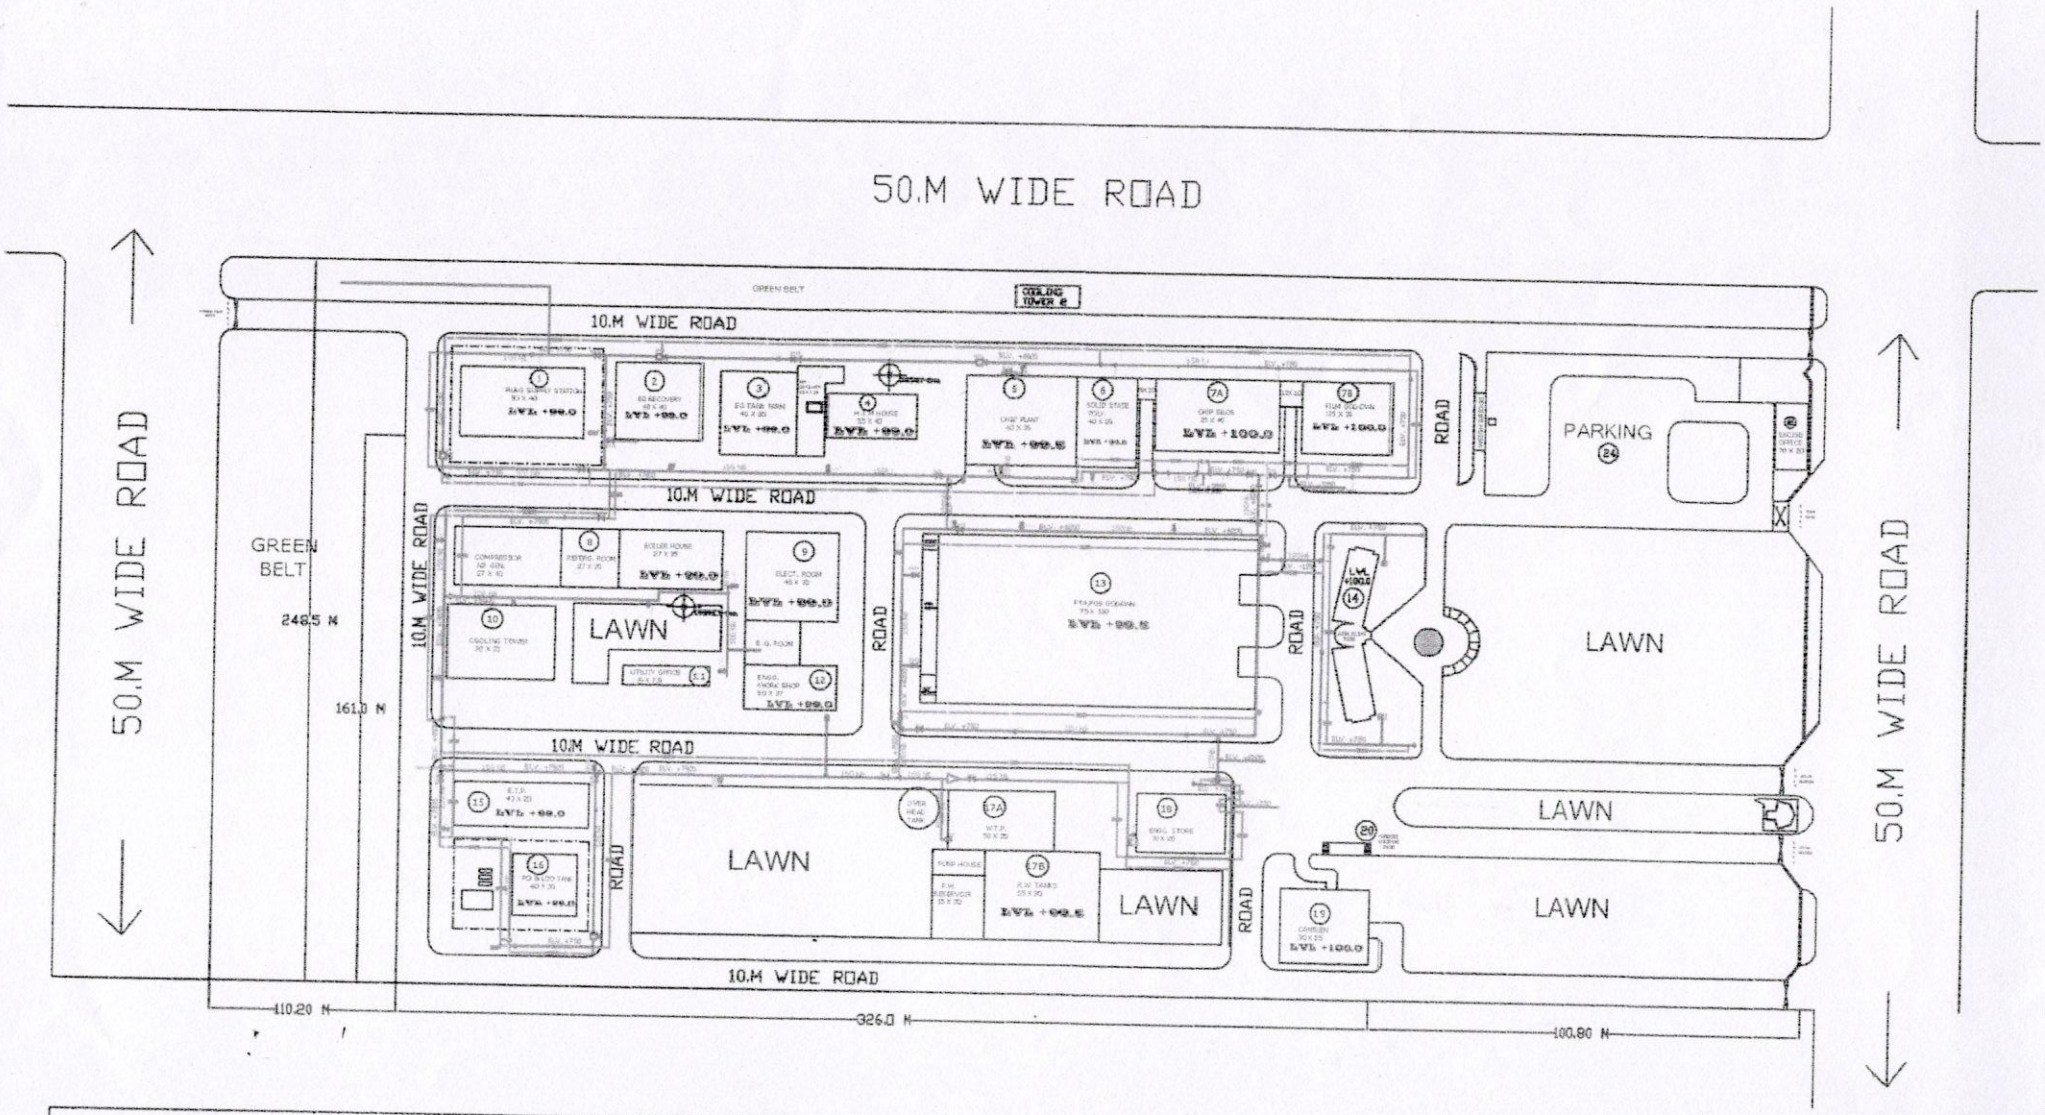

LEGEND

FIRE HYDRANT MAIN		
FIRE HYDRANT VALVE (SV)	=	42 Nos.
FIRE ESCAPE VALVE	=	22 Nos.
FIRE HYDRANT VALVE (DH)	=	01 No.
WATER MONITOR	=	05 Nos.
SLUICE VALVE	=	19 Nos.

REV.NO.	DATE	DESCRIPTION	BY	CHD.	APPD.

REVISION DETAILS

THIS DRAWING IS THE PROPERTY OF M/s MONTAGE ENTERPRISES PVT. LTD.(PET CHIPS DIV.),MHLANPUR,BHIND(M.P.)

M/S MONTAGE ENTERPRISES PVT. LTD (PET CHIP DIVISION)

UNLESS OTHERWISE STATED ALL DIMENSIONS ARE IN mm

SCALE	CAD FILE	NO. OFF
NTS	–	ONE

TITLE

FIRE FIGHTING PIPING LAY OUT OF PLANT

DRAWING NO. MEPL/FIRE-01/17-18

REV. 00

SHEET NO. 01 OF 01