


S I T E   P L A N

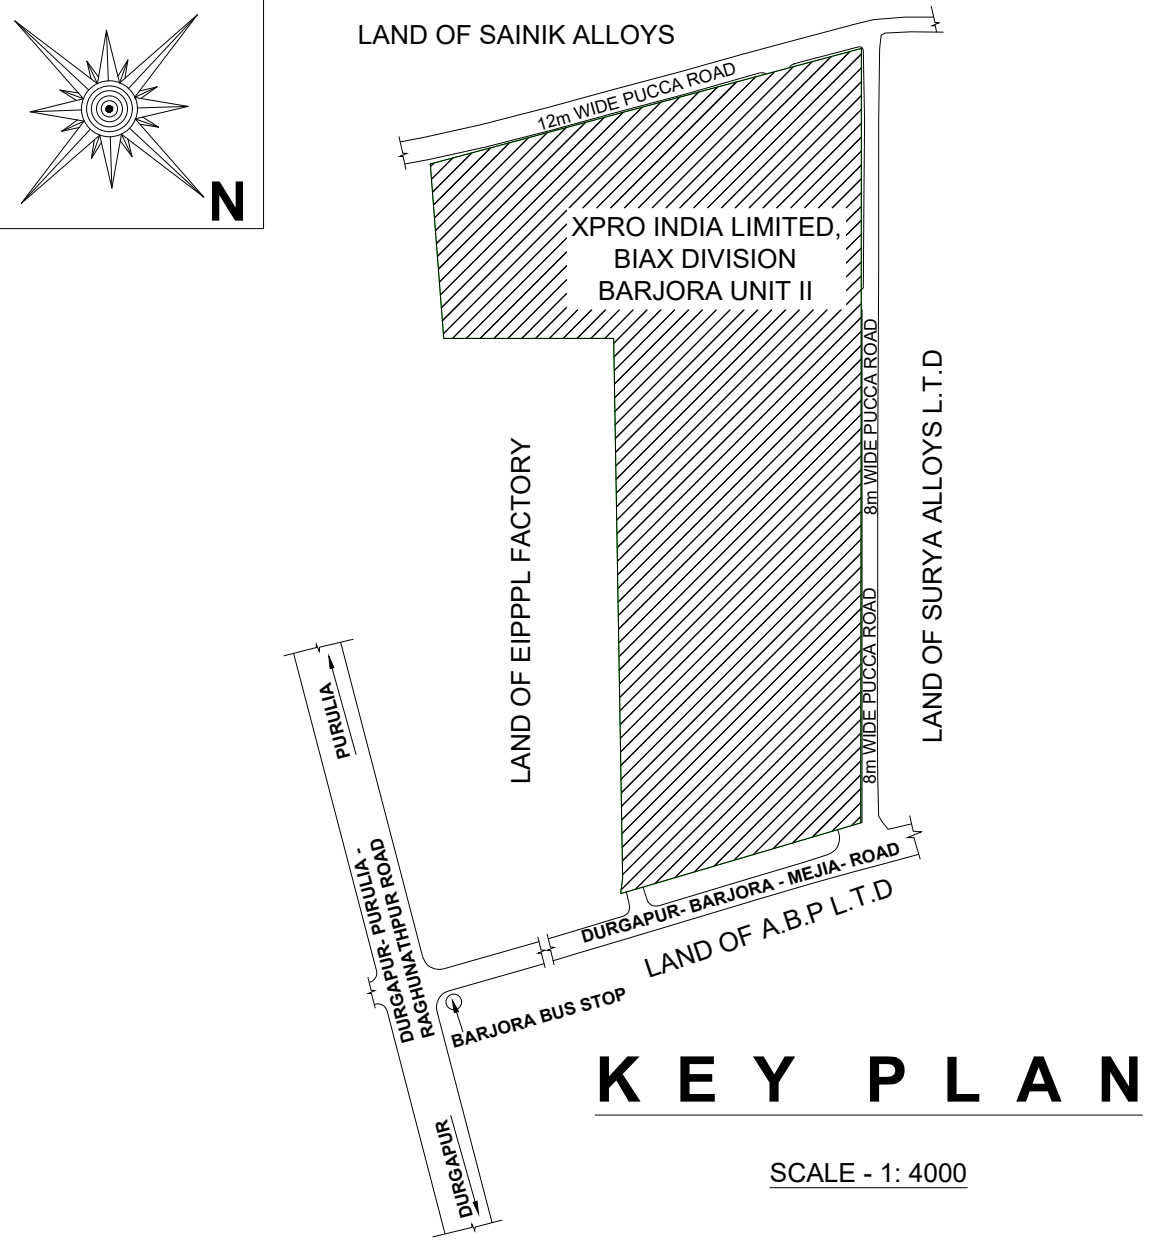

K E Y   P L A N

EXISTING LEGENDS	
SYMBOL	N O M E N C L A T U R E
2	DIELECTRIC (BOPP) CAPACITOR FILMS SHED - 1
3	COOLING TOWER - 1
4	HSD & LDO STORAGE AREA
7	M.S. CHIMNEY
8	SOAK PIT & SEPTIC TANK - 1

PROPOSED LEGENDS		
SYMBOL	N O M E N C L A T U R E	SHEET NO
10A	SECURITY ROOM- 1	02
10B	SECURITY ROOM- 2	02
10C	SECURITY ROOM- 3	02
11	WEIGH BRIDGE	04
12A	FIRE PUMP ROOM	04
12B	SOFTENER TANK	04
12C	FILTER TANK	04
12D	CONTROL ROOM	
13A	FIRE WATER TANK	04
13B	RAW WATER TANK	04
13C	FILTER WATER TANK	04
13D	SOFT WATER TANK	04
14	DIELECTRIC (BOPP) CAPACITOR FILMS SHED - 2	6,7,8,9
14A	LOADING & UNLOADING AREA	6,7,8,9
15	REST ROOM	03
16	D.V.C METER ROOM	02
17	TOILET BLOCK (FOR MALE)	03
18	SCALE ROOM	02
19	DG SHED	04
20	TOILET BLOCK (FOR FEMALE)	03
21	RAW MATERIAL GODOWN	05
22	CYCLE STAND SHED	03
23	GODOWN	
24	HT YARD	
25	CHILLER SHED	06
26	COOLING TOWER - 2	
27	SOAK PIT & SEPTIC TANK - 2	
28	COAL BED METHANE (C.B.M)	

LEGENDS (DEMOLISHED CONSTRUCTION)	
SYMBOL	NOMENCLATURE
1	R.C.C. WATER RESERVIOR
9	LATRINE BLOCK


LEGENDS (EXISTING APPROVED CONSTRUCTION WITH MODIFICATION)		
SYMBOL	N O M E N C L A T U R E	SHEET NO
5	THERMIC FLUID HEATER SHED	
6	H.T. & L.T. ROOM	GR FLOOR
		1ST FLOOR

- NOTE:-
- ALL DIMENSIONS ARE IN MILLIMETER.
  - FACTORY DISTANCE FROM NEAREST BUS STOPPAGE:- BORJORA MORE- 2km. (APPROX).
  - FACTORY DISTANCE FROM NEAREST RAILWAY STATION:- DURGAPUR 12 km. (APPROX).
  - TOTAL NO. OF PROPOSED WORKERS:- 98 NOS; MALE:- 93 NOS, FEMALE:- 05
  - EXISTING NO. OF URINAL: 07 NOS (LENGTH 610mm EACH)  
LATRINE: 07 NOS; BATH WITH DRENCHED SHOWER:NIL; WASH WITH 1 TAP: NIL
  - PROPOSED NO. OF URINAL: 3 NOS (LENGTH 610mm EACH)  
LATRINE: 5 NOS; FOR MALE: 4 NOS, FOR FEMALE: 1; BATH WITH DRENCHED SHOWER: 5NOS; FOR MALE: 4 NOS, FOR FEMALE: 1  
WASH WITH TAP: 4 NOS
  - BOUNDARY WALLS ARE SHOWN IN COLOR
  - "FIRE FIGHTING SYSTEM" AS PER RULE 61 & 62 OF W.B.F.R., 1958 WILL BE ARRANGED. FIRE DETECTION ALARM SUPPRESSION SYSTEM ALTERNATIVE POWER SUPPLY ARRANGEMENT PROVIDED IN THE PLANT AS PER RULE 61 & 62 OF W.B.F.R. 1958.
  - SOURCE OF WATER : WBIDC
  - W.T.- DRINKING WATER TAP & FOR OTHER PURPOSE ; TOTAL COUNT: 3 NOS
  - SOURCE OF ELECTRICITY: DVC
  - ALL ELECTRICAL EQUIPMENTS ARE FLAME-PROOF IN NATURE,
  - ALL EARTH CONNECTIONS ARE STRICTLY COMPLY WITH IS 3043
  - EARTH PITS ARE SHOWN AS
  - GREEN BELT SHALL BE MAINTAINED AS PER C.P.C.B.
  - EXISTING CONSTRUCTION WAS LAST APPROVED BY C. I. F. (W.B.) VIDE APPROVAL NO.- 33, DT.22/02/2013

FIRE PROTECTION SYSTEM	
SYMBOL	D E S C R I P T I O N
<span style="border: 1px solid black; width: 10px; height: 10px; display: inline-block;"></span>	HYDRANT HEADER (OVER GROUND)
<span style="border: 1px solid black; width: 10px; height: 10px; display: inline-block;"></span>	HYDRANT HEADER (UNDER GROUND)
<span style="border: 1px solid black; width: 10px; height: 10px; display: inline-block;"></span>	PILLAR TYPE HYDRANT SYSTEM WITH 100mm INTERNAL DIAMETER PIPE
<span style="border: 1px solid black; width: 10px; height: 10px; display: inline-block;"></span>	HOSE BOXES CONTAINING 2 LENGTHS OF DELIVERY HOSE AND A SHORT BRANCH PIPE AT EACH HYDRANT POINT CONFORMING I.S. SPECIFICATION 3844-1989

I, OCCUPIER OF THIS FACTORY, HERE BY DECLARE THAT THE PREMISES OCCUPIED AS FACTORY AS SHOWN IN THE SITE PLAN IS FREE FROM ANY LEGAL DISPUTE AND COURT CASE AND POSSESS LEGAL AUTHORITY TO CONSTRUCT FACTORY WITHIN THIS PREMISES.

OCCUPIER'S DSC :

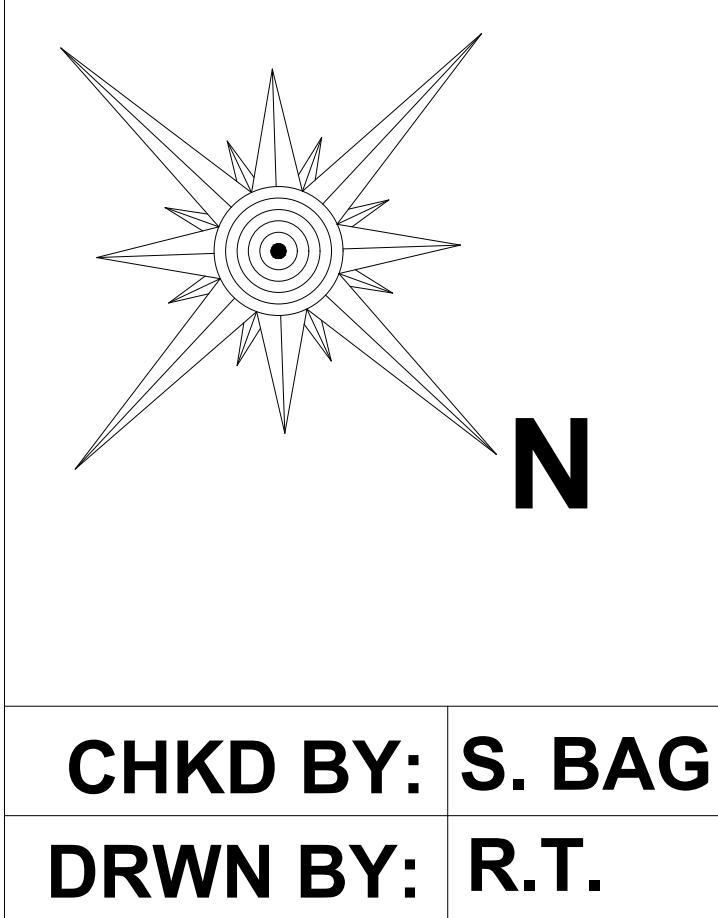

**XPRO INDIA LIMITED BIAX DIVISION  
BARJORA UNIT II**

**BARJORA MEJIA ROAD, P.O. GHUTGORIA S.O, P.S.  
BARJORA, DIST. BANKURA, PIN: 722168**

**PROJECT: DIELECTRIC ( BOPP) CAPACITOR FILMS**

**TITLE : - SITE PLAN**

**CHKD BY: S. BAG  
DRWN BY: R.T.**

**SCALE :- 1:600**

**DRAWING NO:- SB/BQA/XILBDB- 05/24  
SHEET NO :- 1 OF 3**

**REV. - 0  
SIZE :- A0**